


STATESBORO MALL
EXTERIOR LIGHTING PLAN

REV.DATE: 7/25/11
VERIFIED BY: DAVID HUDSON

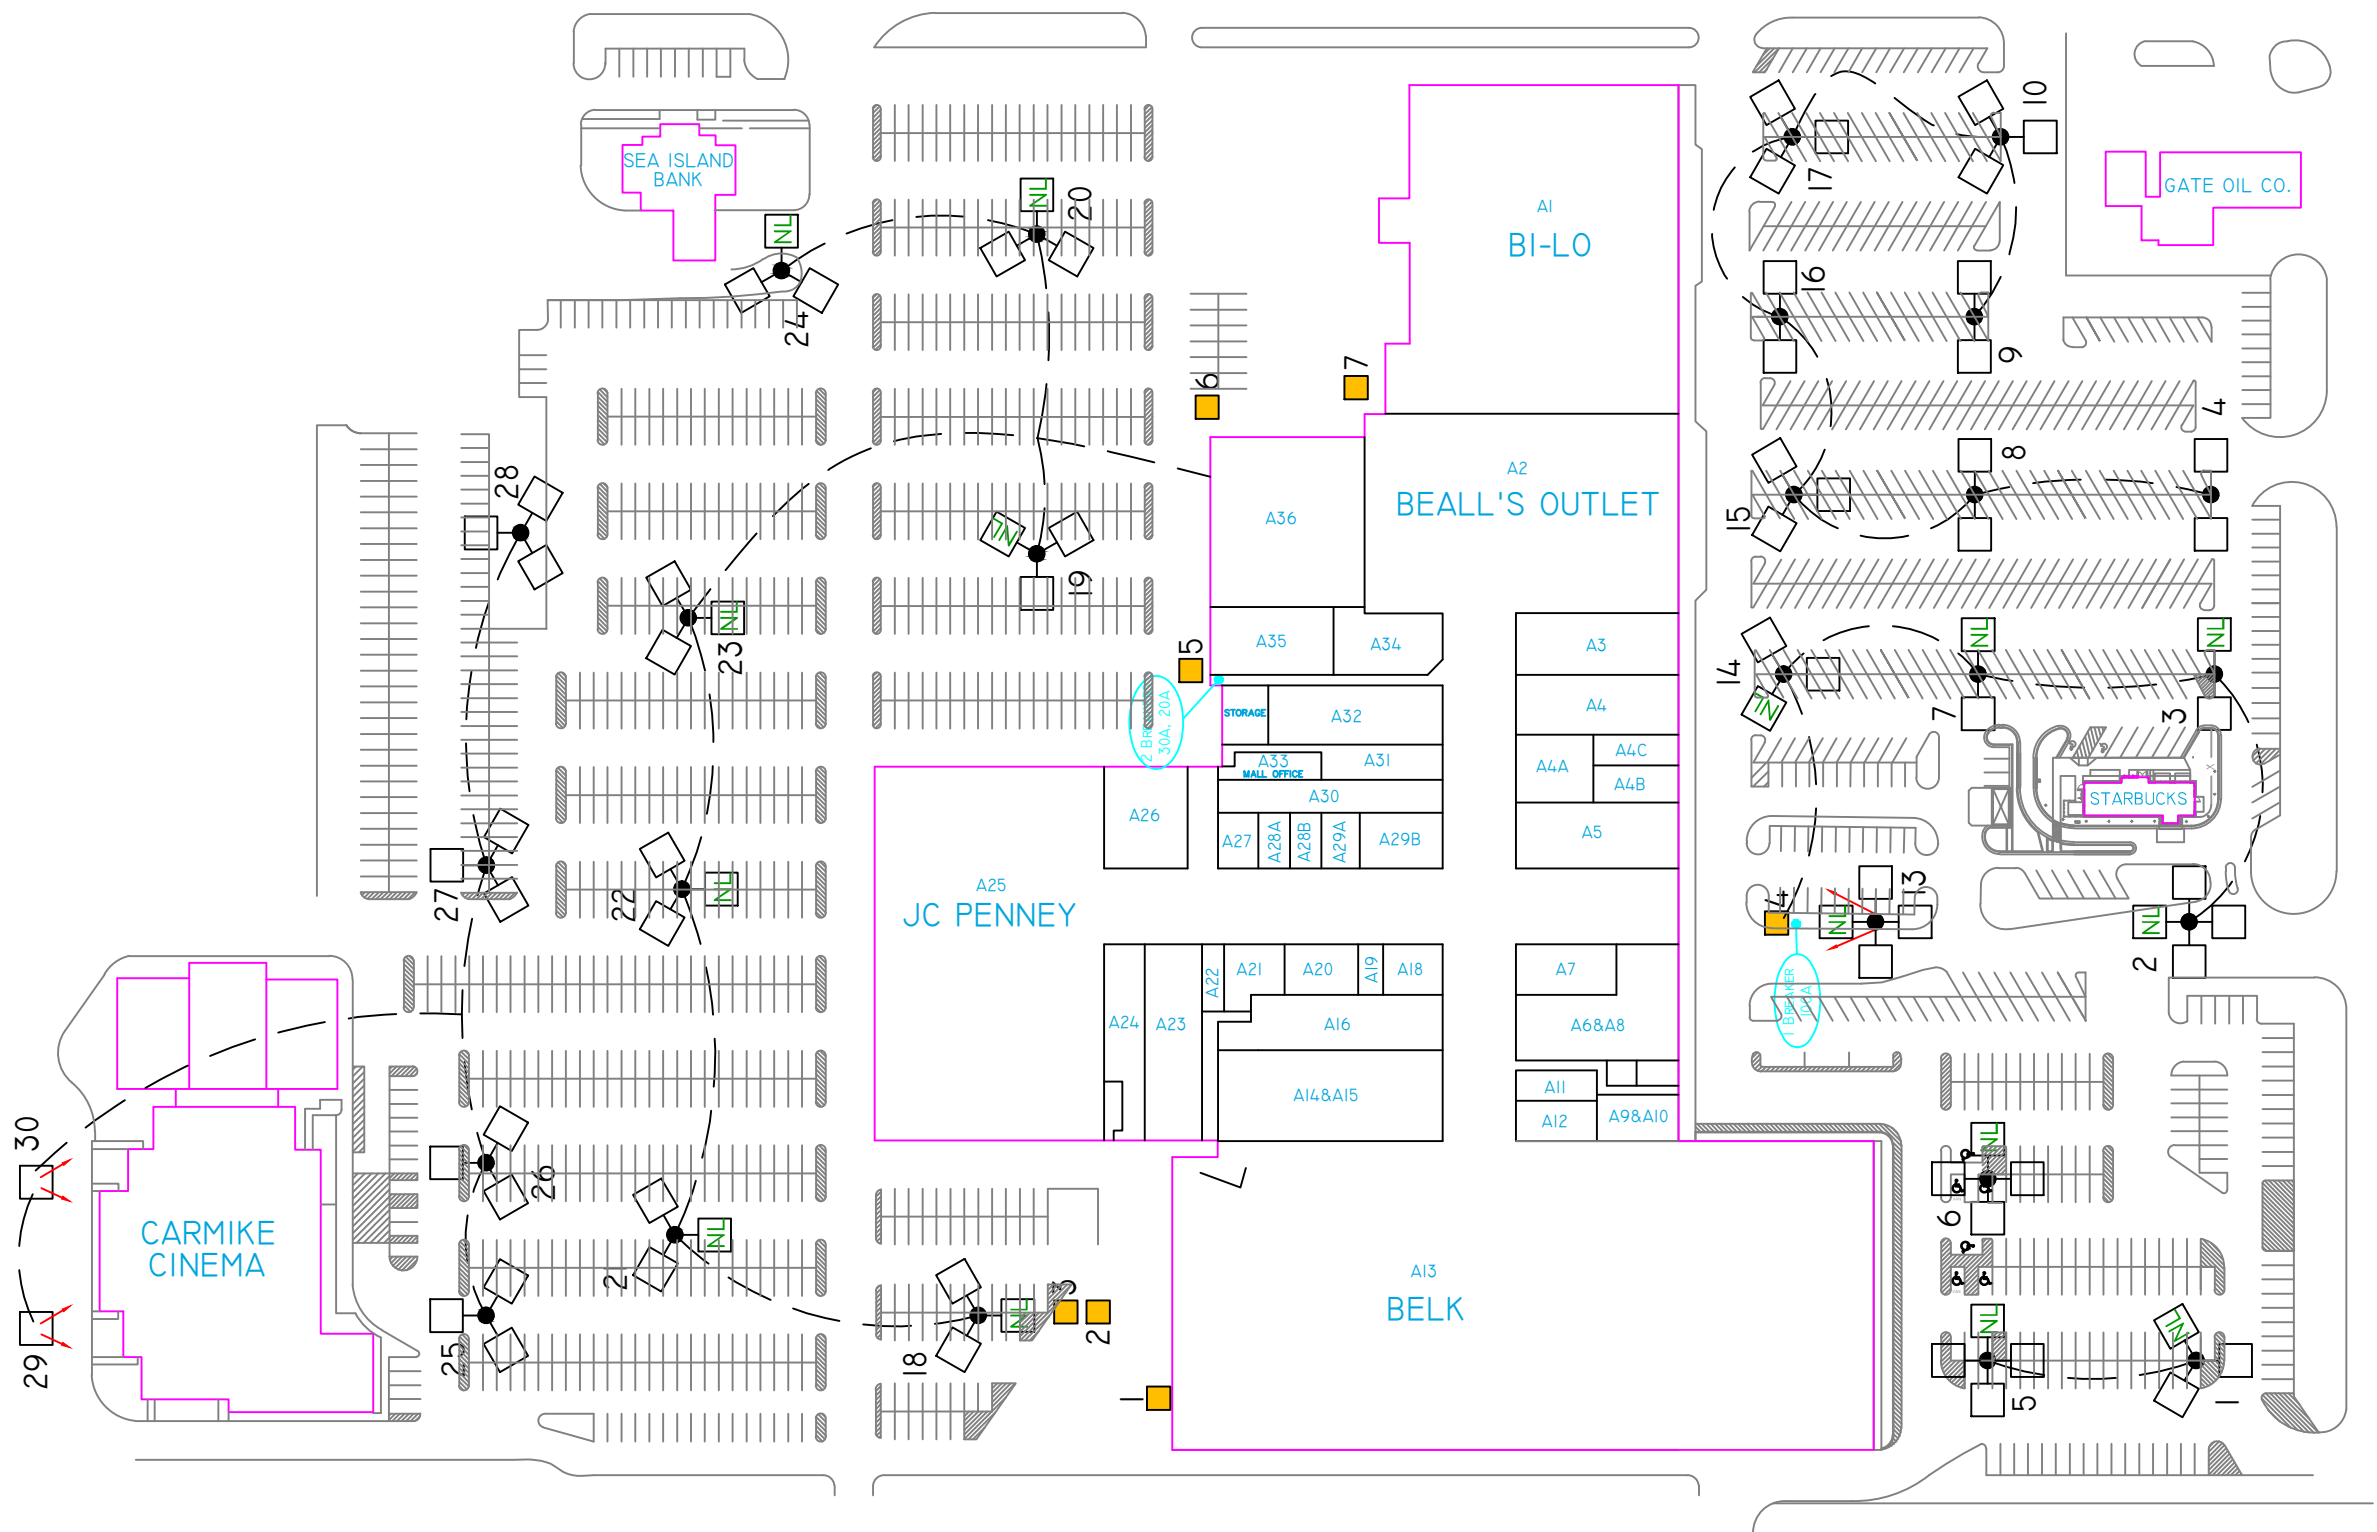

LIGHTING INFORMATION					
POLE NO.	POLE HEIGHT	LAMP TYPE	WATTAGE/VOLTAGE	LAST REPAIR DATE	3YR REPAIR TOTAL
1	47FT	METAL HALIDE	1000/277		
2	47FT	METAL HALIDE	1000/277		
3	47FT	METAL HALIDE	1000/277		
4	47FT	METAL HALIDE	1000/277		
5	47FT	METAL HALIDE	1000/277		
6	47FT	METAL HALIDE	1000/277		
7	47FT	METAL HALIDE	1000/277		
8	47FT	METAL HALIDE	1000/277		
9	47FT	METAL HALIDE	1000/277		
10	47FT	METAL HALIDE	1000/277		
11	47FT	METAL HALIDE	1000/277		
12	47FT	METAL HALIDE	1000/277		
13	47FT	METAL HALIDE	1000/277		
14	47FT	METAL HALIDE	1000/277		
15	47FT	METAL HALIDE	1000/277		
16	47FT	METAL HALIDE	1000/277		
17	47FT	METAL HALIDE	1000/277		
18	47FT	METAL HALIDE	1000/277		
19	47FT	METAL HALIDE	1000/277		
20	47FT	METAL HALIDE	1000/277		
21	47FT	METAL HALIDE	1000/277		
22	47FT	METAL HALIDE	1000/277		
23	47FT	METAL HALIDE	1000/277		
24	47FT	METAL HALIDE	1000/277		
25	47FT	METAL HALIDE	1000/277		
26	47FT	METAL HALIDE	1000/277		
27	47FT	METAL HALIDE	1000/277		
28	47FT	METAL HALIDE	1000/277		
29	47FT	METAL HALIDE	1000/277		
30	47FT	METAL HALIDE	1000/277		

TRANSFORMER INFORMATION		
NO.	TYPE	VOLTAGE
1	STEP DOWN	480/277
2	STEP DOWN	208/120
3	STEP DOWN	480/277
4	STEP DOWN	208/120
5	STEP DOWN	208/120
6	STEP DOWN	480/277
7	STEP DOWN	208/120

- NOTES:
- 1. ALL WIRE IS #6 AWG POLE TO POLE AND #10 AWG TO EACH LIGHT
 - 2. CONDUIT IS 1-1/2"
 - 3. BI-LO LIGHTS ARE ON A SEPERATE TIMER- THERE ARE NO NIGHT LIGHTS ON THAT CIRCUIT
 - 4. ALL PULL BOXES ARE LOCATED AT THE BASE OF EACH POLE

KEY

NL NIGHT LIGHT

BULL HORN LIGHTS

WIRING

TRANSFORMERS

100A PANELS

PULL BOXES

NUMBER OF LIGHTS OUT _____

DATE _____

MANAGER _____