


CLEVELAND MALL EXTERIOR LIGHTING PLAN

REV. DATE: 2/4/2011
VERIFIED BY: DOUG HAMRICK

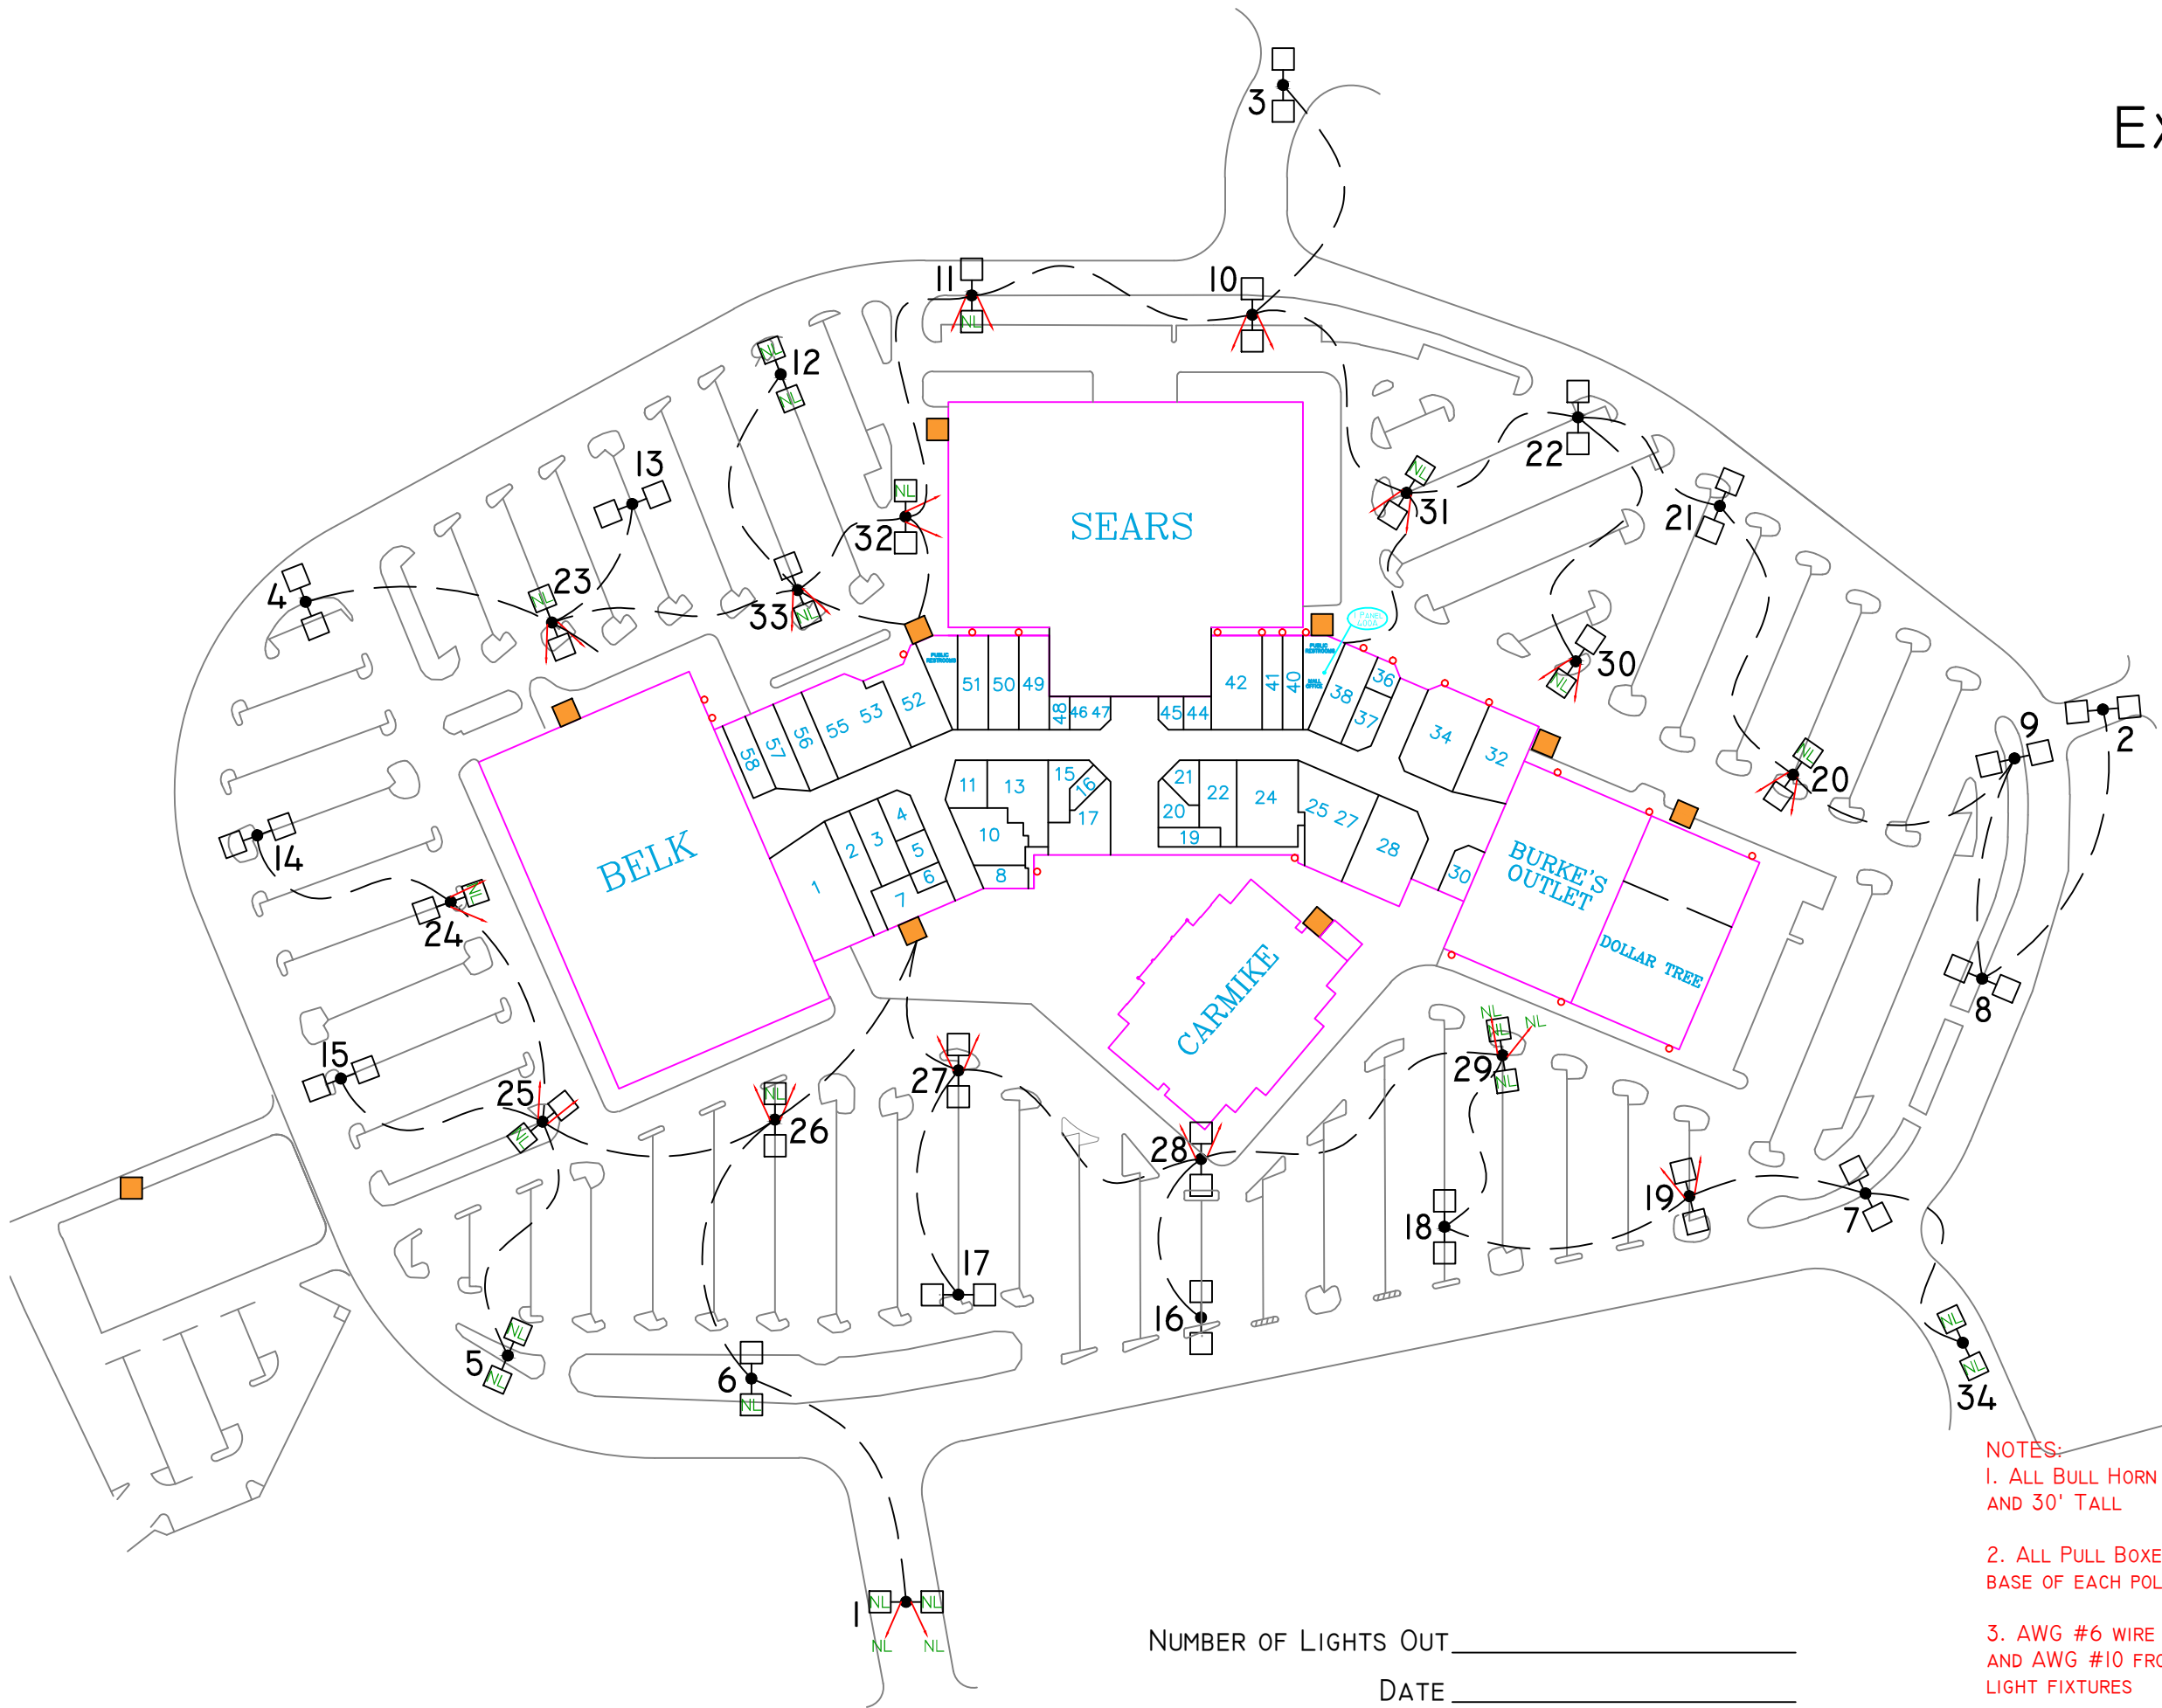

LIGHTING INFORMATION					
POLE NO.	POLE HEIGHT	LAMP TYPE	WATTAGE/VOLTAGE	LAST REPAIR DATE	3YR REPAIR TOTAL
1	50 FT	METAL HALIDE	1000/480		
2	50 FT	METAL HALIDE	1000/480		
3	50 FT	METAL HALIDE	1000/480		
4	50 FT	METAL HALIDE	1000/480		
5	50 FT	METAL HALIDE	1000/480		
6	50 FT	METAL HALIDE	1000/480		
7	50 FT	METAL HALIDE	1000/480		
8	50 FT	METAL HALIDE	1000/480		
9	50 FT	METAL HALIDE	1000/480		
10	50 FT	METAL HALIDE	1000/480		
11	50 FT	METAL HALIDE	1000/480		
12	50 FT	METAL HALIDE	1000/480		
13	50 FT	METAL HALIDE	1000/480		
14	50 FT	METAL HALIDE	1000/480		
15	50 FT	METAL HALIDE	1000/480		
16	50 FT	METAL HALIDE	1000/480		
17	50 FT	METAL HALIDE	1000/480		
18	50 FT	METAL HALIDE	1000/480		
19	50 FT	METAL HALIDE	1000/480		
20	50 FT	METAL HALIDE	1000/480		
21	50 FT	METAL HALIDE	1000/480		
22	50 FT	METAL HALIDE	1000/480		
23	50 FT	METAL HALIDE	1000/480		
24	50 FT	METAL HALIDE	1000/480		
25	50 FT	METAL HALIDE	1000/480		
26	50 FT	METAL HALIDE	1000/480		
27	50 FT	METAL HALIDE	1000/480		
28	50 FT	METAL HALIDE	1000/480		
29	50 FT	METAL HALIDE	1000/480		
30	50 FT	METAL HALIDE	1000/480		
31	50 FT	METAL HALIDE	1000/480		
32	50 FT	METAL HALIDE	1000/480		
33	50 FT	METAL HALIDE	1000/480		
34	50 FT	METAL HALIDE	1000/480		
36	50 FT	METAL HALIDE	1000/480		

- NOTES:
- 1. ALL BULL HORN LIGHTING IS 400 WATTS AND 30' TALL
 - 2. ALL PULL BOXES ARE LOCATED AT THE BASE OF EACH POLE
 - 3. AWG #6 WIRE FEEDS EACH LIGHT POLE AND AWG #10 FROM BASE OF EACH POLE TO LIGHT FIXTURES
 - 4. ALL CONDUIT IS 1"

KEY

NL NIGHT LIGHT

↓ ↓

BULL HORN LIGHTS

— \

WIRING

■

TRANSFORMERS

100A

PANELS

■

PULL BOXES

○

WALL PACKS

NUMBER OF LIGHTS OUT _____

DATE _____

MANAGER _____