


VICTORIA MALL
EXTERIOR LIGHTING PLAN

REV.DATE: 8/13/08
VERIFIED BY: KYLE BERG

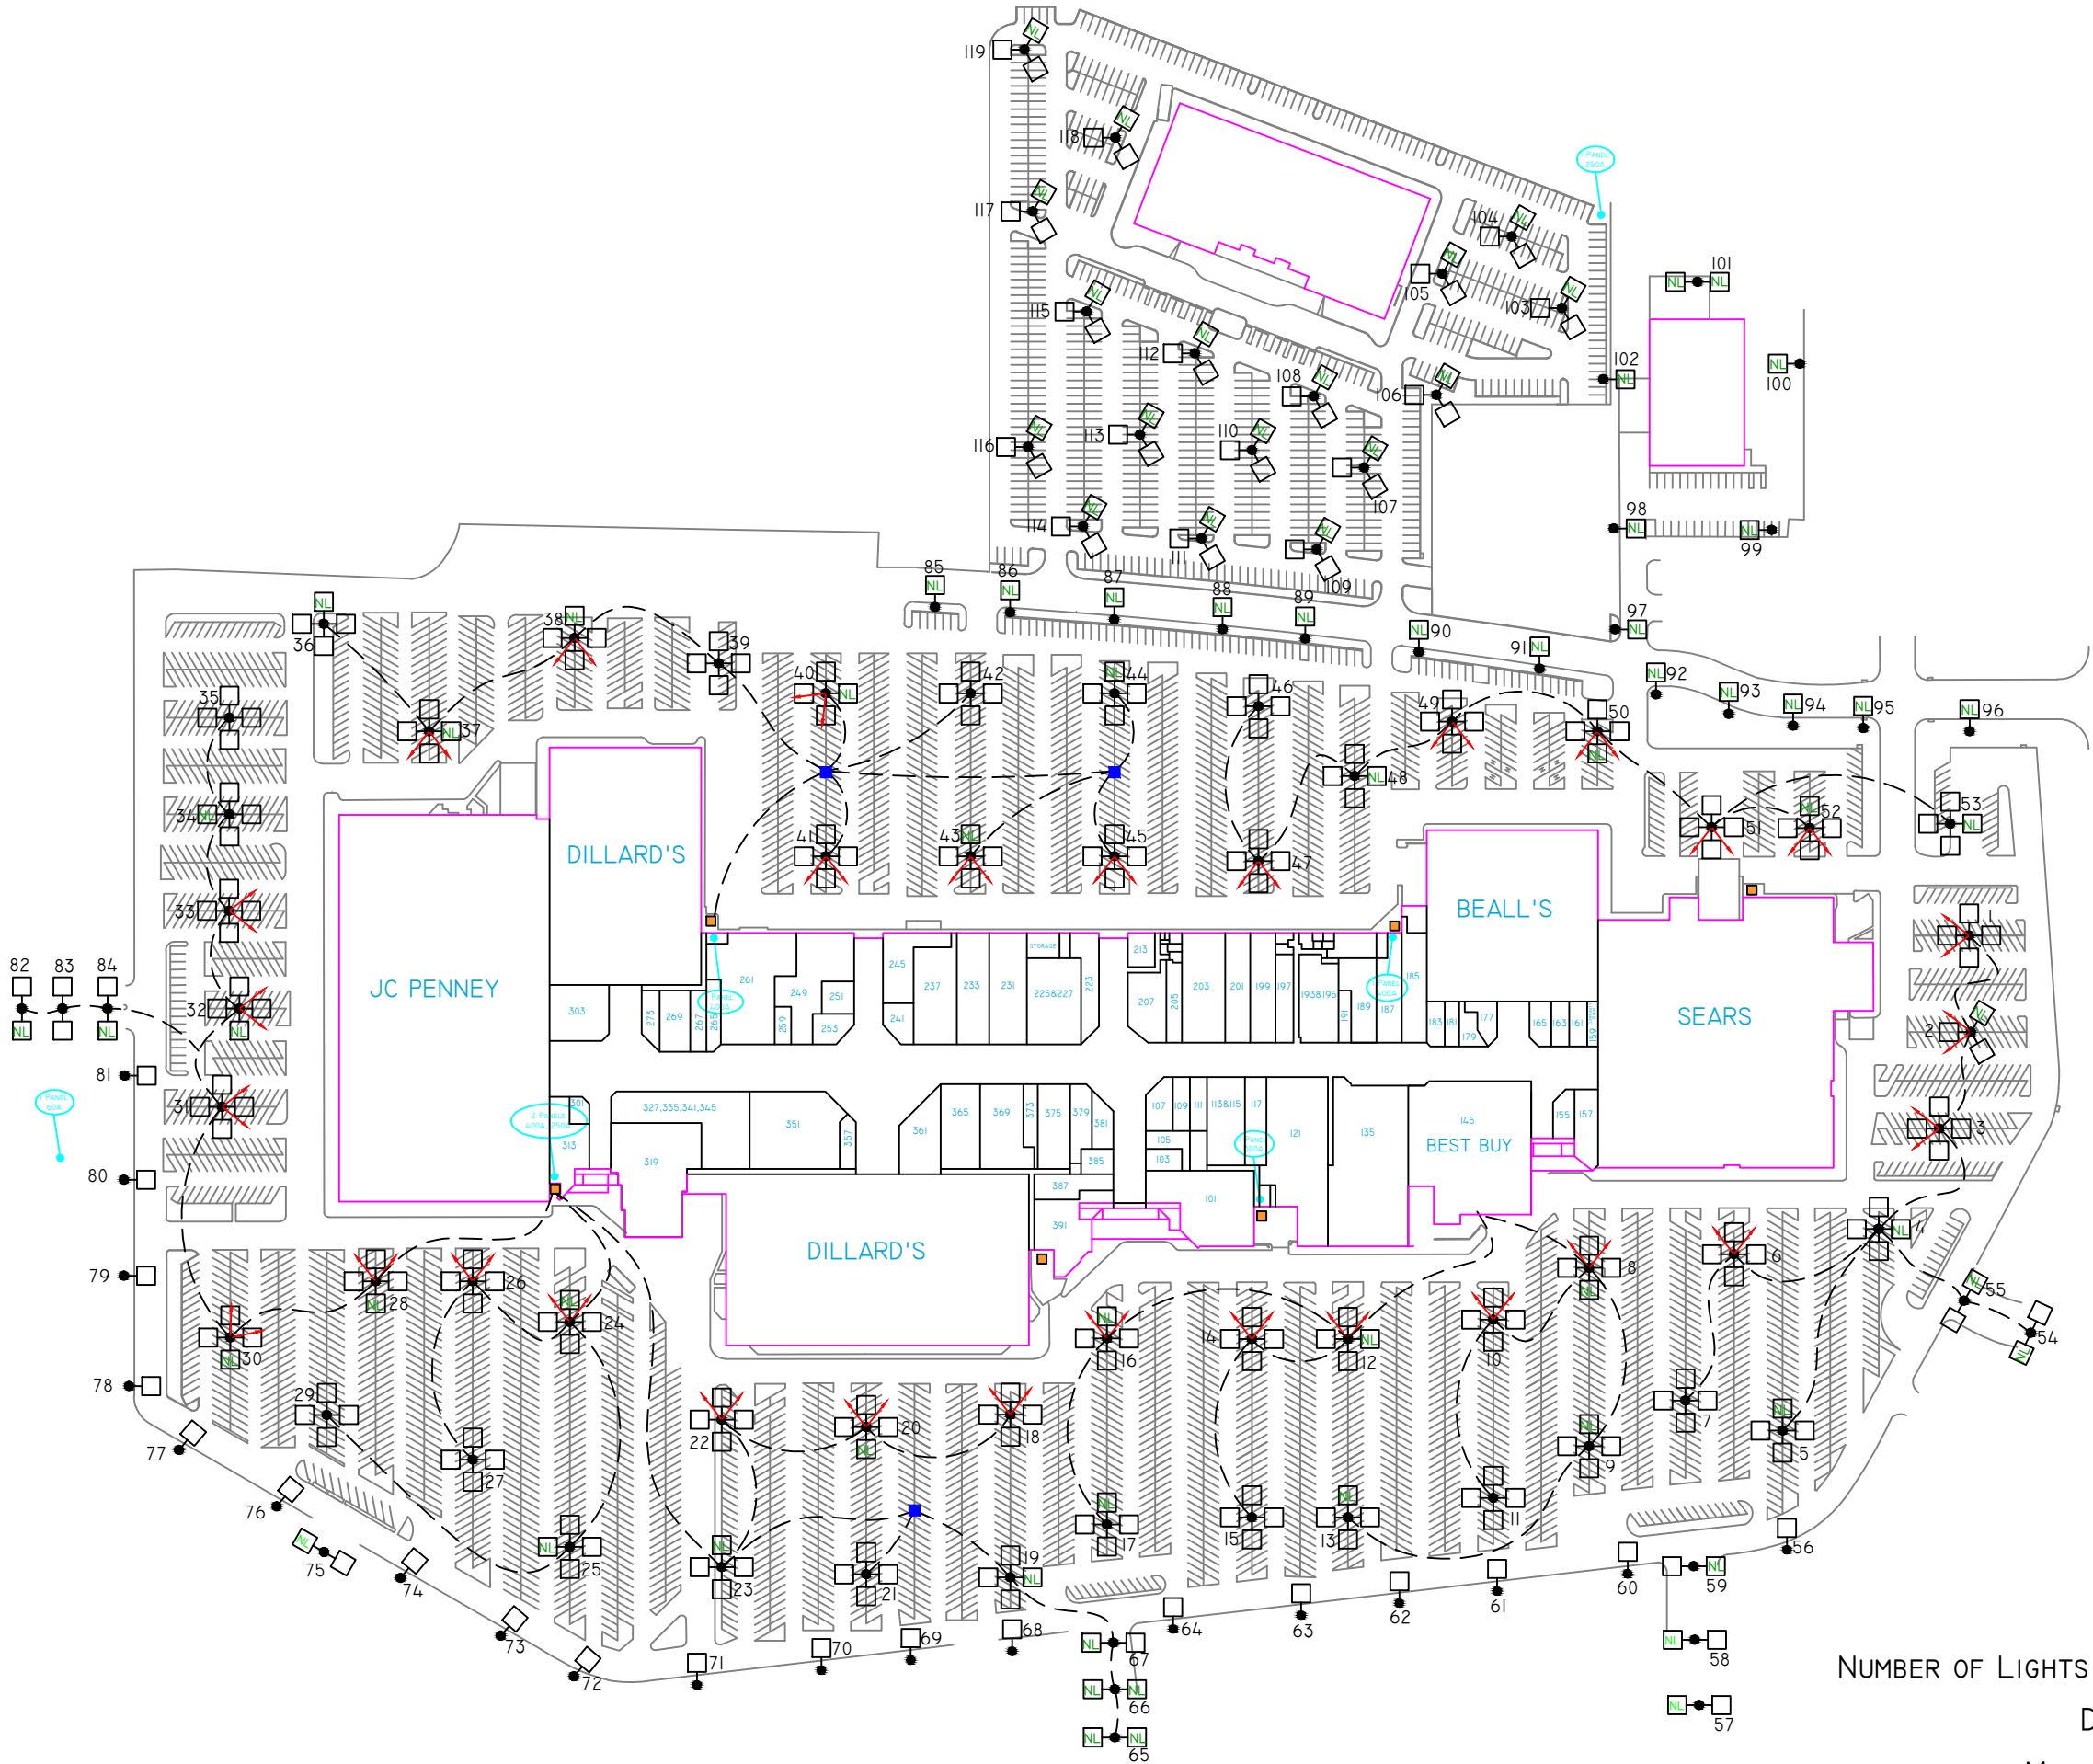

LIGHTING INFORMATION					
Pole No.	Pole Height	Lamp Type	Wattage/Voltage	Last Repair Date	3yr Repair Total
1	50ft	HPS	1000/480		
2	50ft	HPS	1000/480		
3	50ft	HPS	1000/480		
4	50ft	HPS	1000/480		
5	50ft	HPS	1000/480		
6	50ft	HPS	1000/480		
7	50ft	HPS	1000/480		
8	50ft	HPS	1000/480		
9	50ft	HPS	1000/480		
10	50ft	HPS	1000/480		
11	50ft	HPS	1000/480		
12	50ft	HPS	1000/480		
13	50ft	HPS	1000/480		
14	50ft	HPS	1000/480		
15	50ft	HPS	1000/480		
16	50ft	HPS	1000/480		
17	50ft	HPS	1000/480		
18	50ft	HPS	1000/480		
19	50ft	HPS	1000/480		
20	50ft	HPS	1000/480		
21	50ft	HPS	1000/480		
22	50ft	HPS	1000/480		
23	50ft	HPS	1000/480		
24	50ft	HPS	1000/480		
25	50ft	HPS	1000/480		
26	50ft	HPS	1000/480		
27	50ft	HPS	1000/480		
28	50ft	HPS	1000/480		
29	50ft	HPS	1000/480		
30	50ft	HPS	1000/480		
31	50ft	HPS	1000/480		
32	50ft	HPS	1000/480		
33	50ft	HPS	1000/480		
34	50ft	HPS	1000/480		
35	50ft	HPS	1000/480		
36	50ft	HPS	1000/480		
37	50ft	HPS	1000/480		
38	50ft	HPS	1000/480		
39	50ft	HPS	1000/480		
40	50ft	HPS	1000/480		
41	50ft	HPS	1000/480		
42	50ft	HPS	1000/480		
43	50ft	HPS	1000/480		
44	50ft	HPS	1000/480		
45	50ft	HPS	1000/480		
46	50ft	HPS	1000/480		
47	50ft	HPS	1000/480		
48	50ft	HPS	1000/480		
49	50ft	HPS	1000/480		
50	50ft	HPS	1000/480		
51	50ft	HPS	1000/480		
52	50ft	HPS	1000/480		
53	50ft	HPS	1000/480		

- NOTES:
- 1. ALL PULL BOXES ARE LOCATED AT THE BOTTOM OF EACH POLE.
 - 2. ALL WIRE IS #6AWG
 - 3. ALL CONDUIT IS 1-1/2"

KEY

NL NIGHT LIGHT

↓ ↓

BULL HORN LIGHTS

WIRING

■

TRANSFORMERS

100A

PANELS

■

PULL BOXES

NUMBER OF LIGHTS OUT _____

DATE _____

MANAGER _____