


REGENCY SQUARE MALL
EXTERIOR LIGHTING PLAN

REV. DATE: 8/26/08
VERIFIED BY: TOMMY RICHARDSON

- NOTES:
- 1. ALL PULL BOXES ARE LOCATED AT THE BASE OF EACH POLE
 - 2. WIRE TO EACH POLE IS #6 AWG.
WIRE TO EACH LIGHT IS #10 AWG.
 - 3. ALL CONDUIT IS 1-1/2"

LIGHTING INFORMATION					
Pole No.	Pole Height	Lamp Type	Wattage/Voltage	Last Repair Date	3yr Repair Total
1	60ft	Metal Halide	1000/480		
2	20ft	Metal Halide	1000/480		
3	20ft	Metal Halide	1000/480		
4	60ft	Metal Halide	1000/480		
5	60ft	Metal Halide	1000/480		
6	60ft	Metal Halide	1000/480		
7	60ft	Metal Halide	1000/480		
8	60ft	Metal Halide	1000/480		
9	20ft	Metal Halide	1000/480		
10	20ft	Metal Halide	1000/480		
11	60ft	Metal Halide	1000/480		
12	60ft	Metal Halide	1000/480		
13	60ft	Metal Halide	1000/480		
14	60ft	Metal Halide	1000/480		
15	20ft	Metal Halide	1000/480		
16	20ft	Metal Halide	1000/480		
17	60ft	Metal Halide	1000/480		
18	60ft	Metal Halide	1000/480		
19	60ft	Metal Halide	1000/480		
20	60ft	Metal Halide	1000/480		
21	60ft	Metal Halide	1000/480		
22	60ft	Metal Halide	1000/480		
23	60ft	Metal Halide	1000/480		
24	60ft	Metal Halide	1000/480		
25	60ft	Metal Halide	1000/480		
26	60ft	Metal Halide	1000/480		
27	60ft	Metal Halide	1000/480		
28	60ft	Metal Halide	1000/480		
29	20ft	Metal Halide	1000/480		
30	60ft	Metal Halide	1000/480		
31	60ft	Metal Halide	1000/480		
32	60ft	Metal Halide	1000/480		
33	60ft	Metal Halide	1000/480		
34	60ft	Metal Halide	1000/480		
35	60ft	Metal Halide	1000/480		
36	20ft	Metal Halide	1000/480		
37	60ft	Metal Halide	1000/480		
38	60ft	Metal Halide	1000/480		
39	60ft	Metal Halide	1000/480		
40	60ft	Metal Halide	1000/480		
41	60ft	Metal Halide	1000/480		
42	60ft	Metal Halide	1000/480		

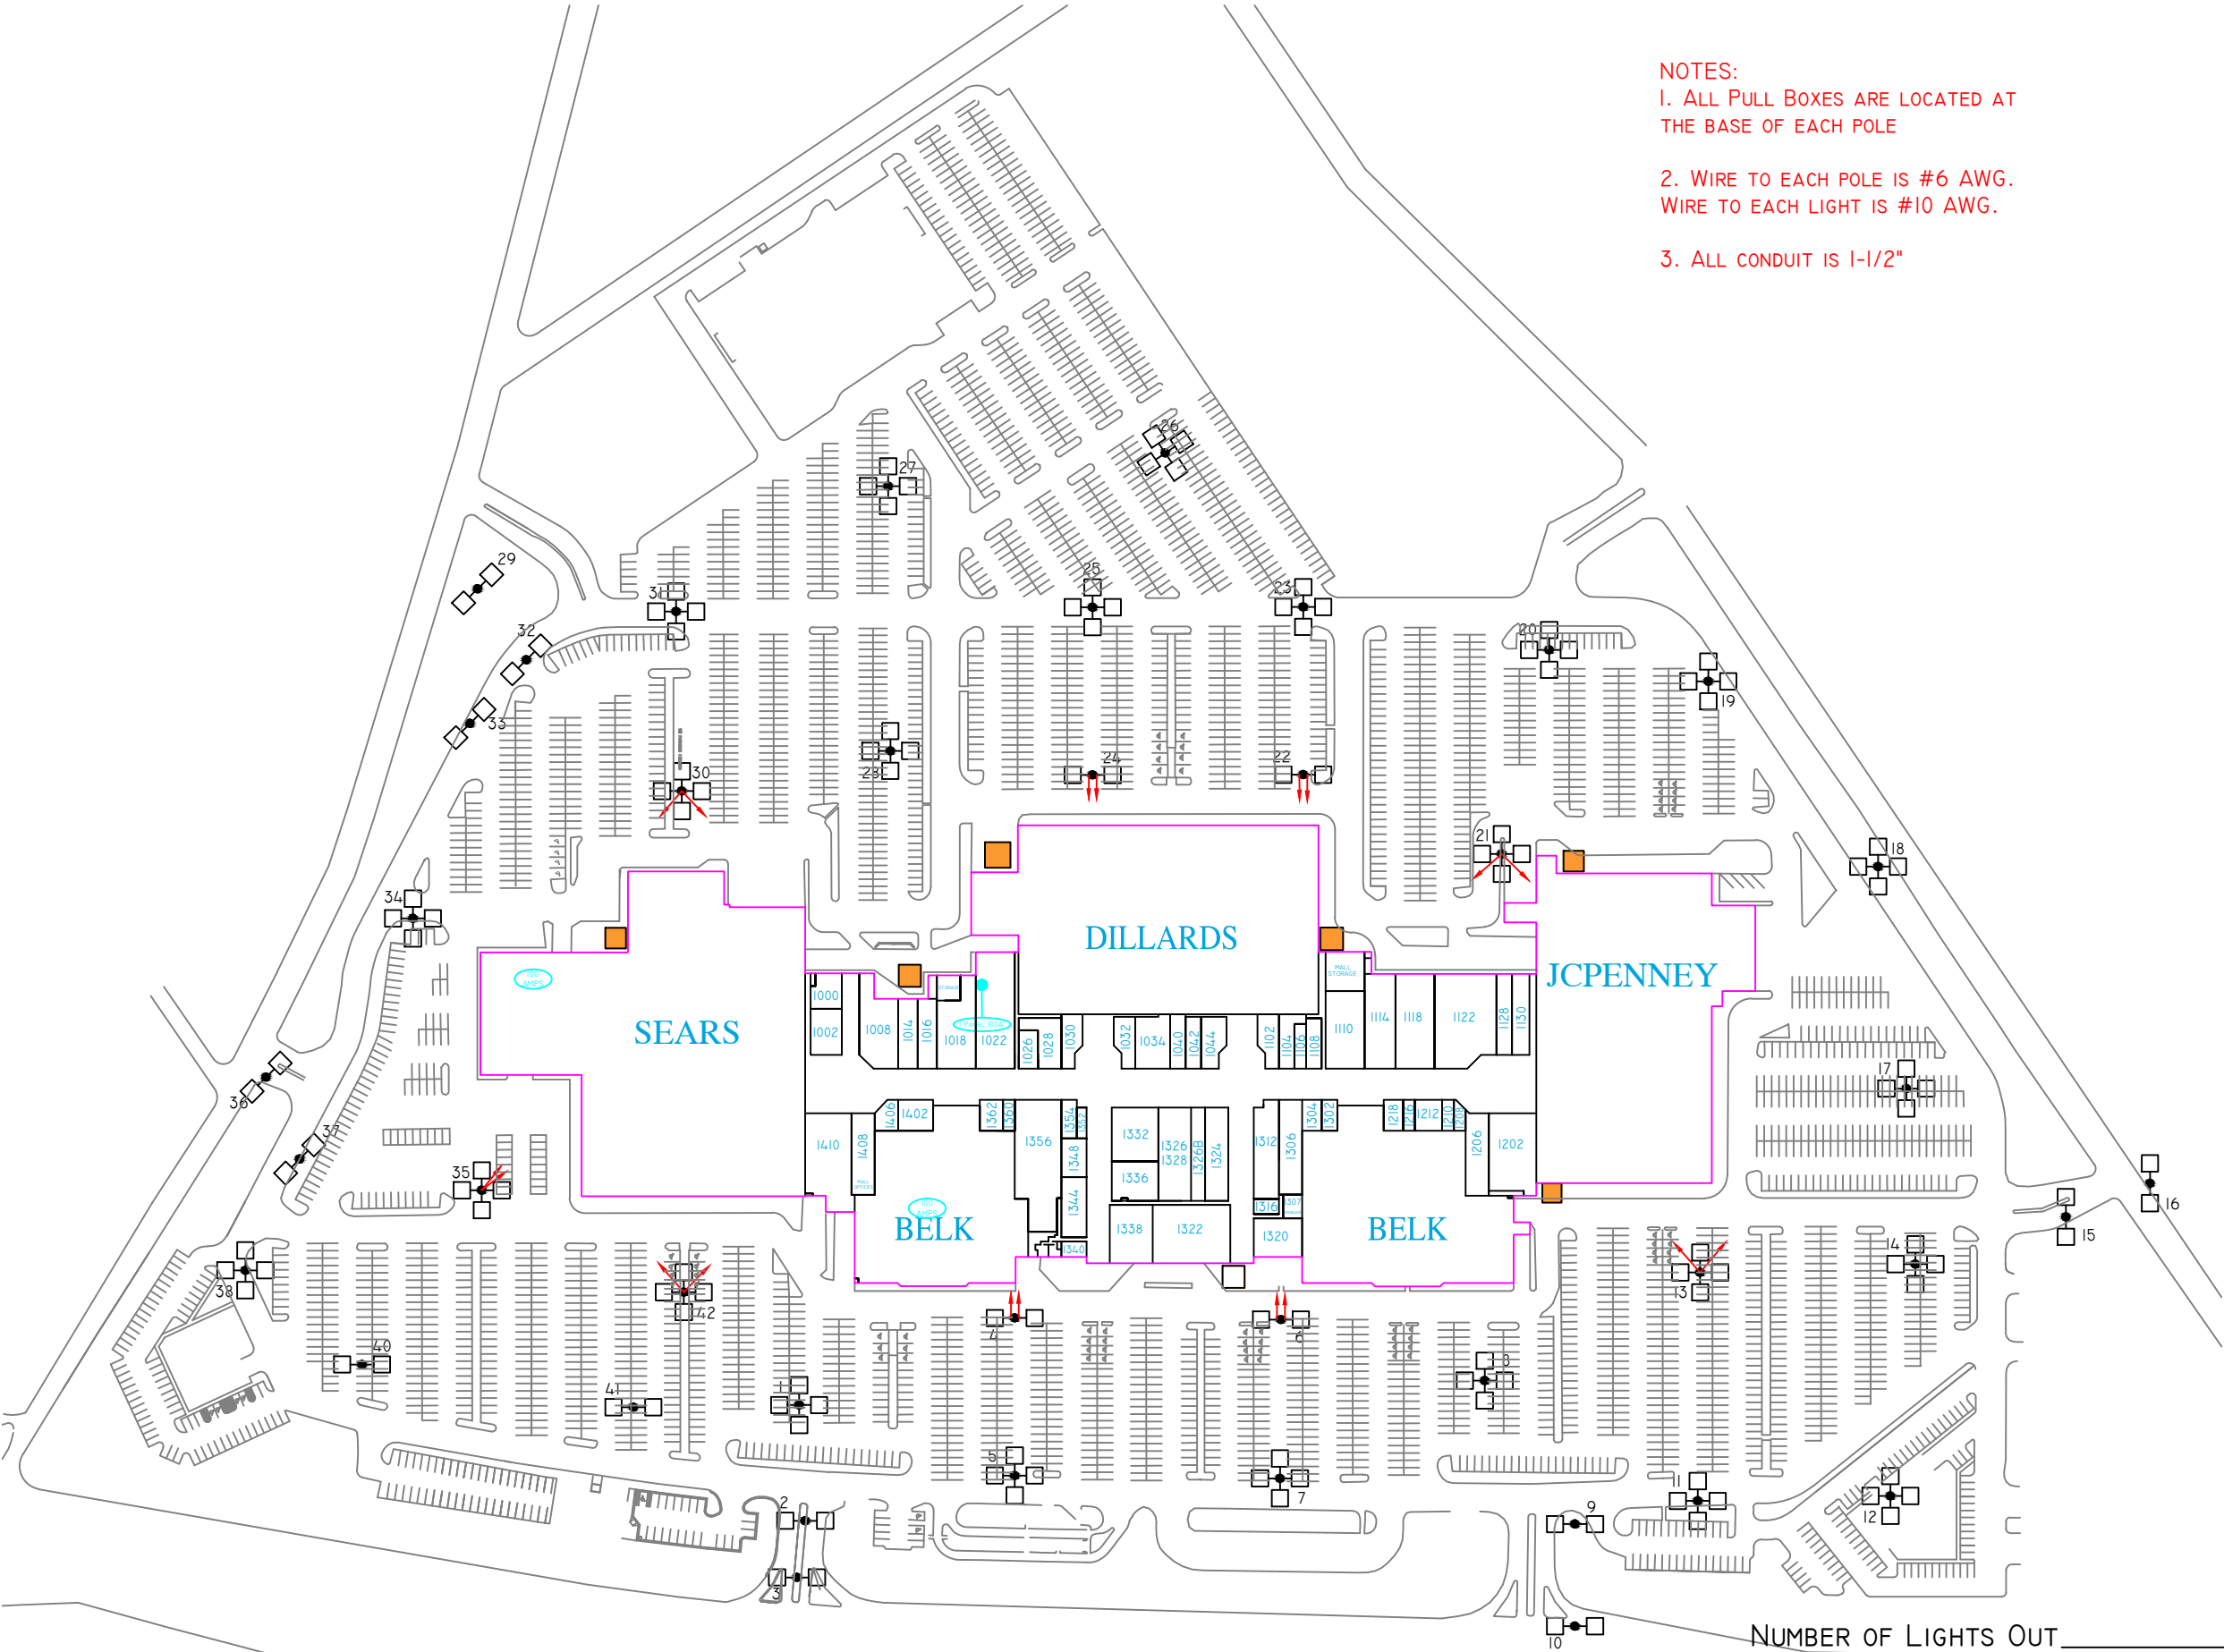

NUMBER OF LIGHTS OUT _____
DATE _____
MANAGER _____

KEY

NL NIGHT LIGHT

BULL HORN LIGHTS

WIRING

TRANSFORMERS

100
AMPS

PANELS

PULL BOXES