

LAKE CITY MALL EXTERIOR LIGHTING PLAN

REV.DATE: 1/27/10
VERIFIED BY: JANICE DORMINEY

- NOTES:
- 1. ALL PULL BOXES LOCATED AT THE BASE OF EACH POLE.
 - 2. ALL WIRE IS #6 AWG
 - 3. ALL CONDUIT IS 1-1/2"

LIGHTING INFORMATION					
Pole No.	Pole Height	Lamp Type	Wattage/Voltage	Last Repair Date	3yr Repair Total
1	50ft	Metal Halide	1000/460		
2	50ft	Metal Halide	1000/460		
3	50ft	Metal Halide	1000/460		
4	50ft	Metal Halide	1000/460		
5	50ft	Metal Halide	1000/460		
6	50ft	Metal Halide	1000/460		
7	50ft	Metal Halide	1000/460		
8	50ft	Metal Halide	1000/460		
9	50ft	Metal Halide	1000/460		
10	50ft	Metal Halide	1000/460		
11	50ft	Metal Halide	1000/460		
12	50ft	Metal Halide	1000/460		
13	50ft	Metal Halide	1000/460		
14	50ft	Metal Halide	1000/460		
15	50ft	Metal Halide	1000/460		
16	50ft	Metal Halide	1000/460		
17	50ft	Metal Halide	1000/460		
18	50ft	Metal Halide	1000/460		
19	50ft	Metal Halide	1000/460		
20	50ft	Metal Halide	1000/460		

KEY

NL NIGHT LIGHT

↓ ↓

BULL HORN LIGHTS

— —


WIRING

TRANSFORMERS

100A

PANELS

PULL BOXES

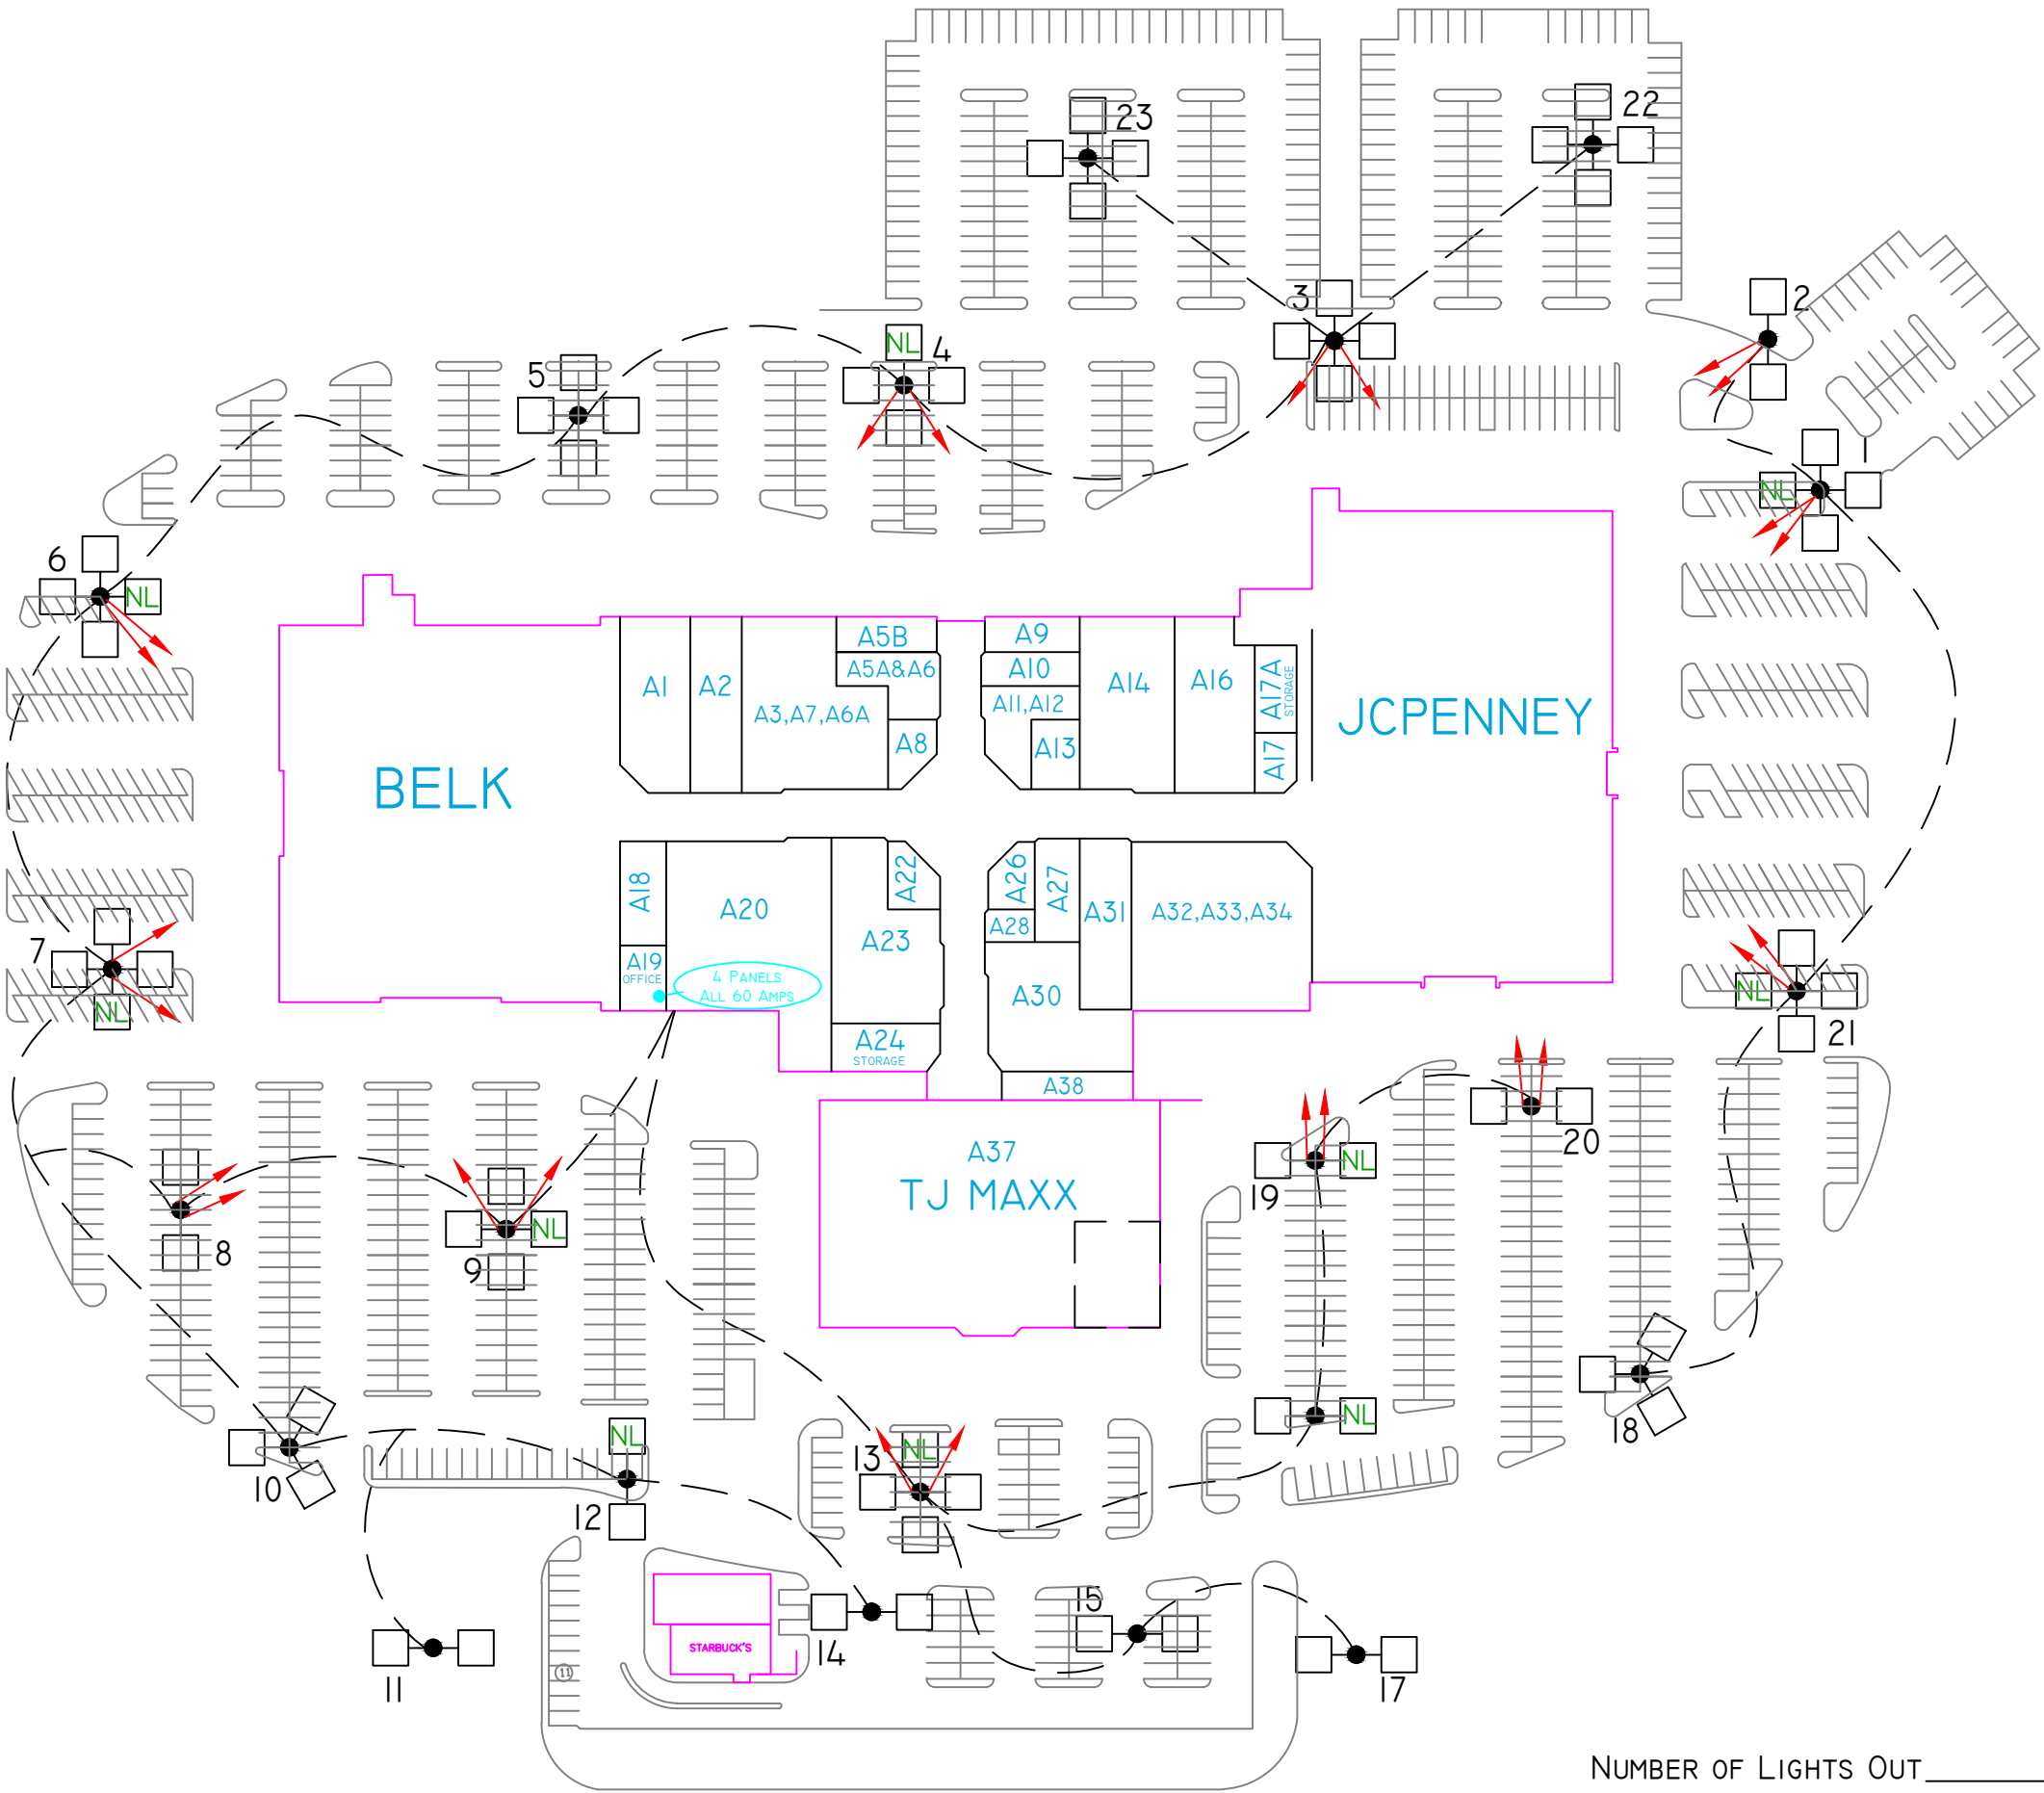

NUMBER OF LIGHTS OUT _____

DATE _____

MANAGER _____