


CAROLINA MALL
EXTERIOR LIGHTING PLAN

REV.DATE: 1/14/2013
VERIFIED BY: CHARLES HARPER

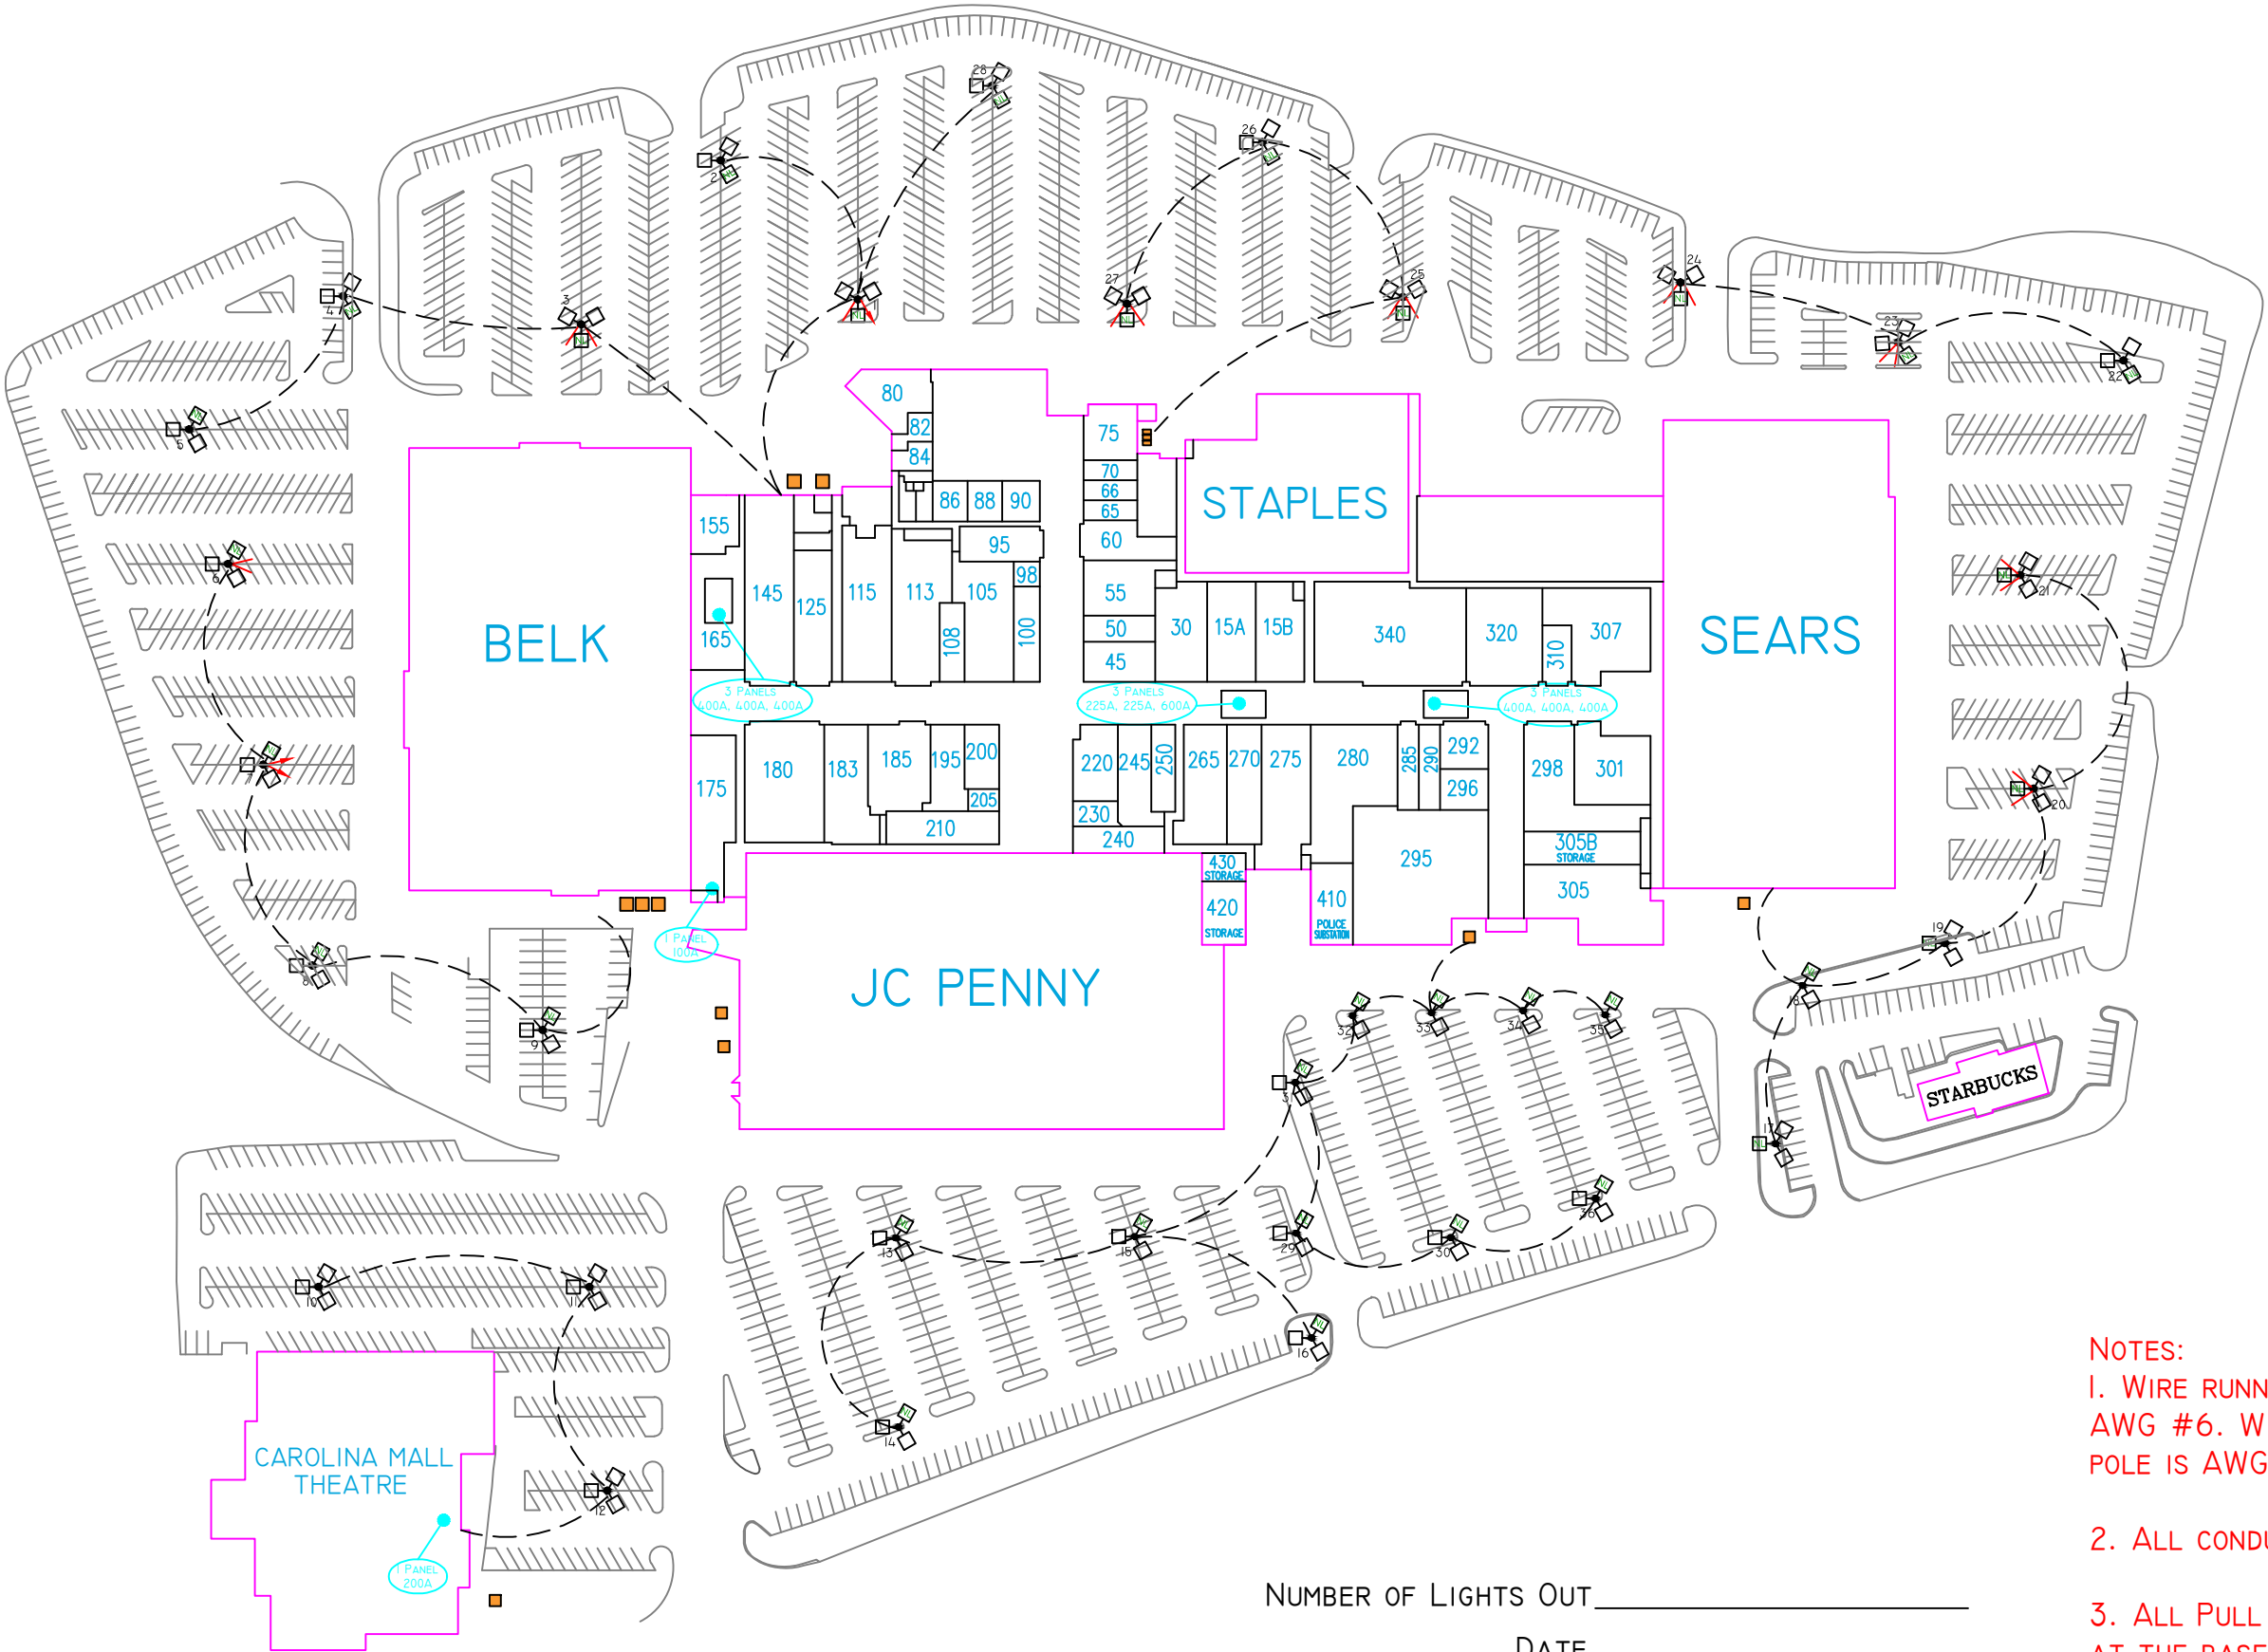

LIGHTING INFORMATION					
Pole No.	Pole Height	Lamp Type	Wattage/Voltage	Last Repair Date	3yr Repair Total
1	40 ft	Metal Halide	1000/480		
2	40 ft	Metal Halide	1000/480		
3	40 ft	Metal Halide	1000/480		
4	40 ft	Metal Halide	1000/480		
5	40 ft	Metal Halide	1000/480		
6	40 ft	Metal Halide	1000/480		
7	40 ft	Metal Halide	1000/480		
8	40 ft	Metal Halide	1000/480		
9	40 ft	Metal Halide	1000/480		
10	40 ft	Metal Halide	1000/480		
11	40 ft	Metal Halide	1000/480		
12	40 ft	Metal Halide	1000/480		
13	40 ft	Metal Halide	1000/480		
14	40 ft	Metal Halide	1000/480		
15	40 ft	Metal Halide	1000/480		
16	40 ft	Metal Halide	1000/480		
17	40 ft	Metal Halide	1000/480		
18	40 ft	Metal Halide	1000/480		
19	40 ft	Metal Halide	1000/480		
20	40 ft	Metal Halide	1000/480		
21	40 ft	Metal Halide	1000/480		
22	40 ft	Metal Halide	1000/480		
23	40 ft	Metal Halide	1000/480		
24	40 ft	Metal Halide	1000/480		
25	40 ft	Metal Halide	1000/480		
26	40 ft	Metal Halide	1000/480		
27	40 ft	Metal Halide	1000/480		
28	40 ft	Metal Halide	1000/480		

- NOTES:
- 1. WIRE RUNNING TO EACH POLE IS AWG #6. WIRE RUNNING UP EACH POLE IS AWG #8.
 - 2. ALL CONDUIT IS 1-1/2".
 - 3. ALL PULL BOXES ARE LOCATED AT THE BASE OF EACH POLE.

KEY

NL NIGHT LIGHT

↓ ↓

BULL HORN LIGHTS

WIRING

■

TRANSFORMERS

100 AMP

PANELS

■

PULL BOXES

NUMBER OF LIGHTS OUT _____

DATE _____

MANAGER _____